TK-1300	BH-1250	V-1200	K-600	TK-101	TK-102	TK-103	FS-1300	FA-1300
100BBL POP TANK	BUILDING HEATER	TEST SEPARATOR	AIR COMPRESSORS	OIL TANK	OIL TANK	OIL TANK	FLARE STACK	FLAME ARRESTOR
S/N: AKS 376 YEAR: 2021 SIZE: 9'6"ø x 8' DESIGN PRESSURE: 16oz	MAKE: NORSEMAN 3000W MODEL NO.: XB3-4300T2D83T S/N: NE231721583 600V/3P/60Hz	MAKE: EAGLE OILFIELD SERVICES M.A.W.P: 500PSI @ 130°F CRN#: TBD S/N: TBD YEAR: TBD	MODEL: CAMPBELL HAUSFELD CAPACITY:60 GALLON 1HP@1725RPM US MOTORS 115V/1P/60HZ	CAPACITY: 400BBL SIZE: 12'ø x 20' S/N: 400113 YEAR: 2005 DESIGN PRESSURE: 16oz	CAPACITY: 400BBL SIZE: 12'ø x 20' S/N: 014065 YEAR: 2005 DESIGN PRESSURE: 16oz	CAPACITY: 400BBL SIZE: 12'ø x 20' 40094 YEAR: 2005 DESIGN PRESSURE: 16oz	120V IGNITOR 4" X 40' STACK C/W 24" X 5' TALL IKO INLET: 4" 150# RFWN	3" WELD-IN FLAME ARRESTOR

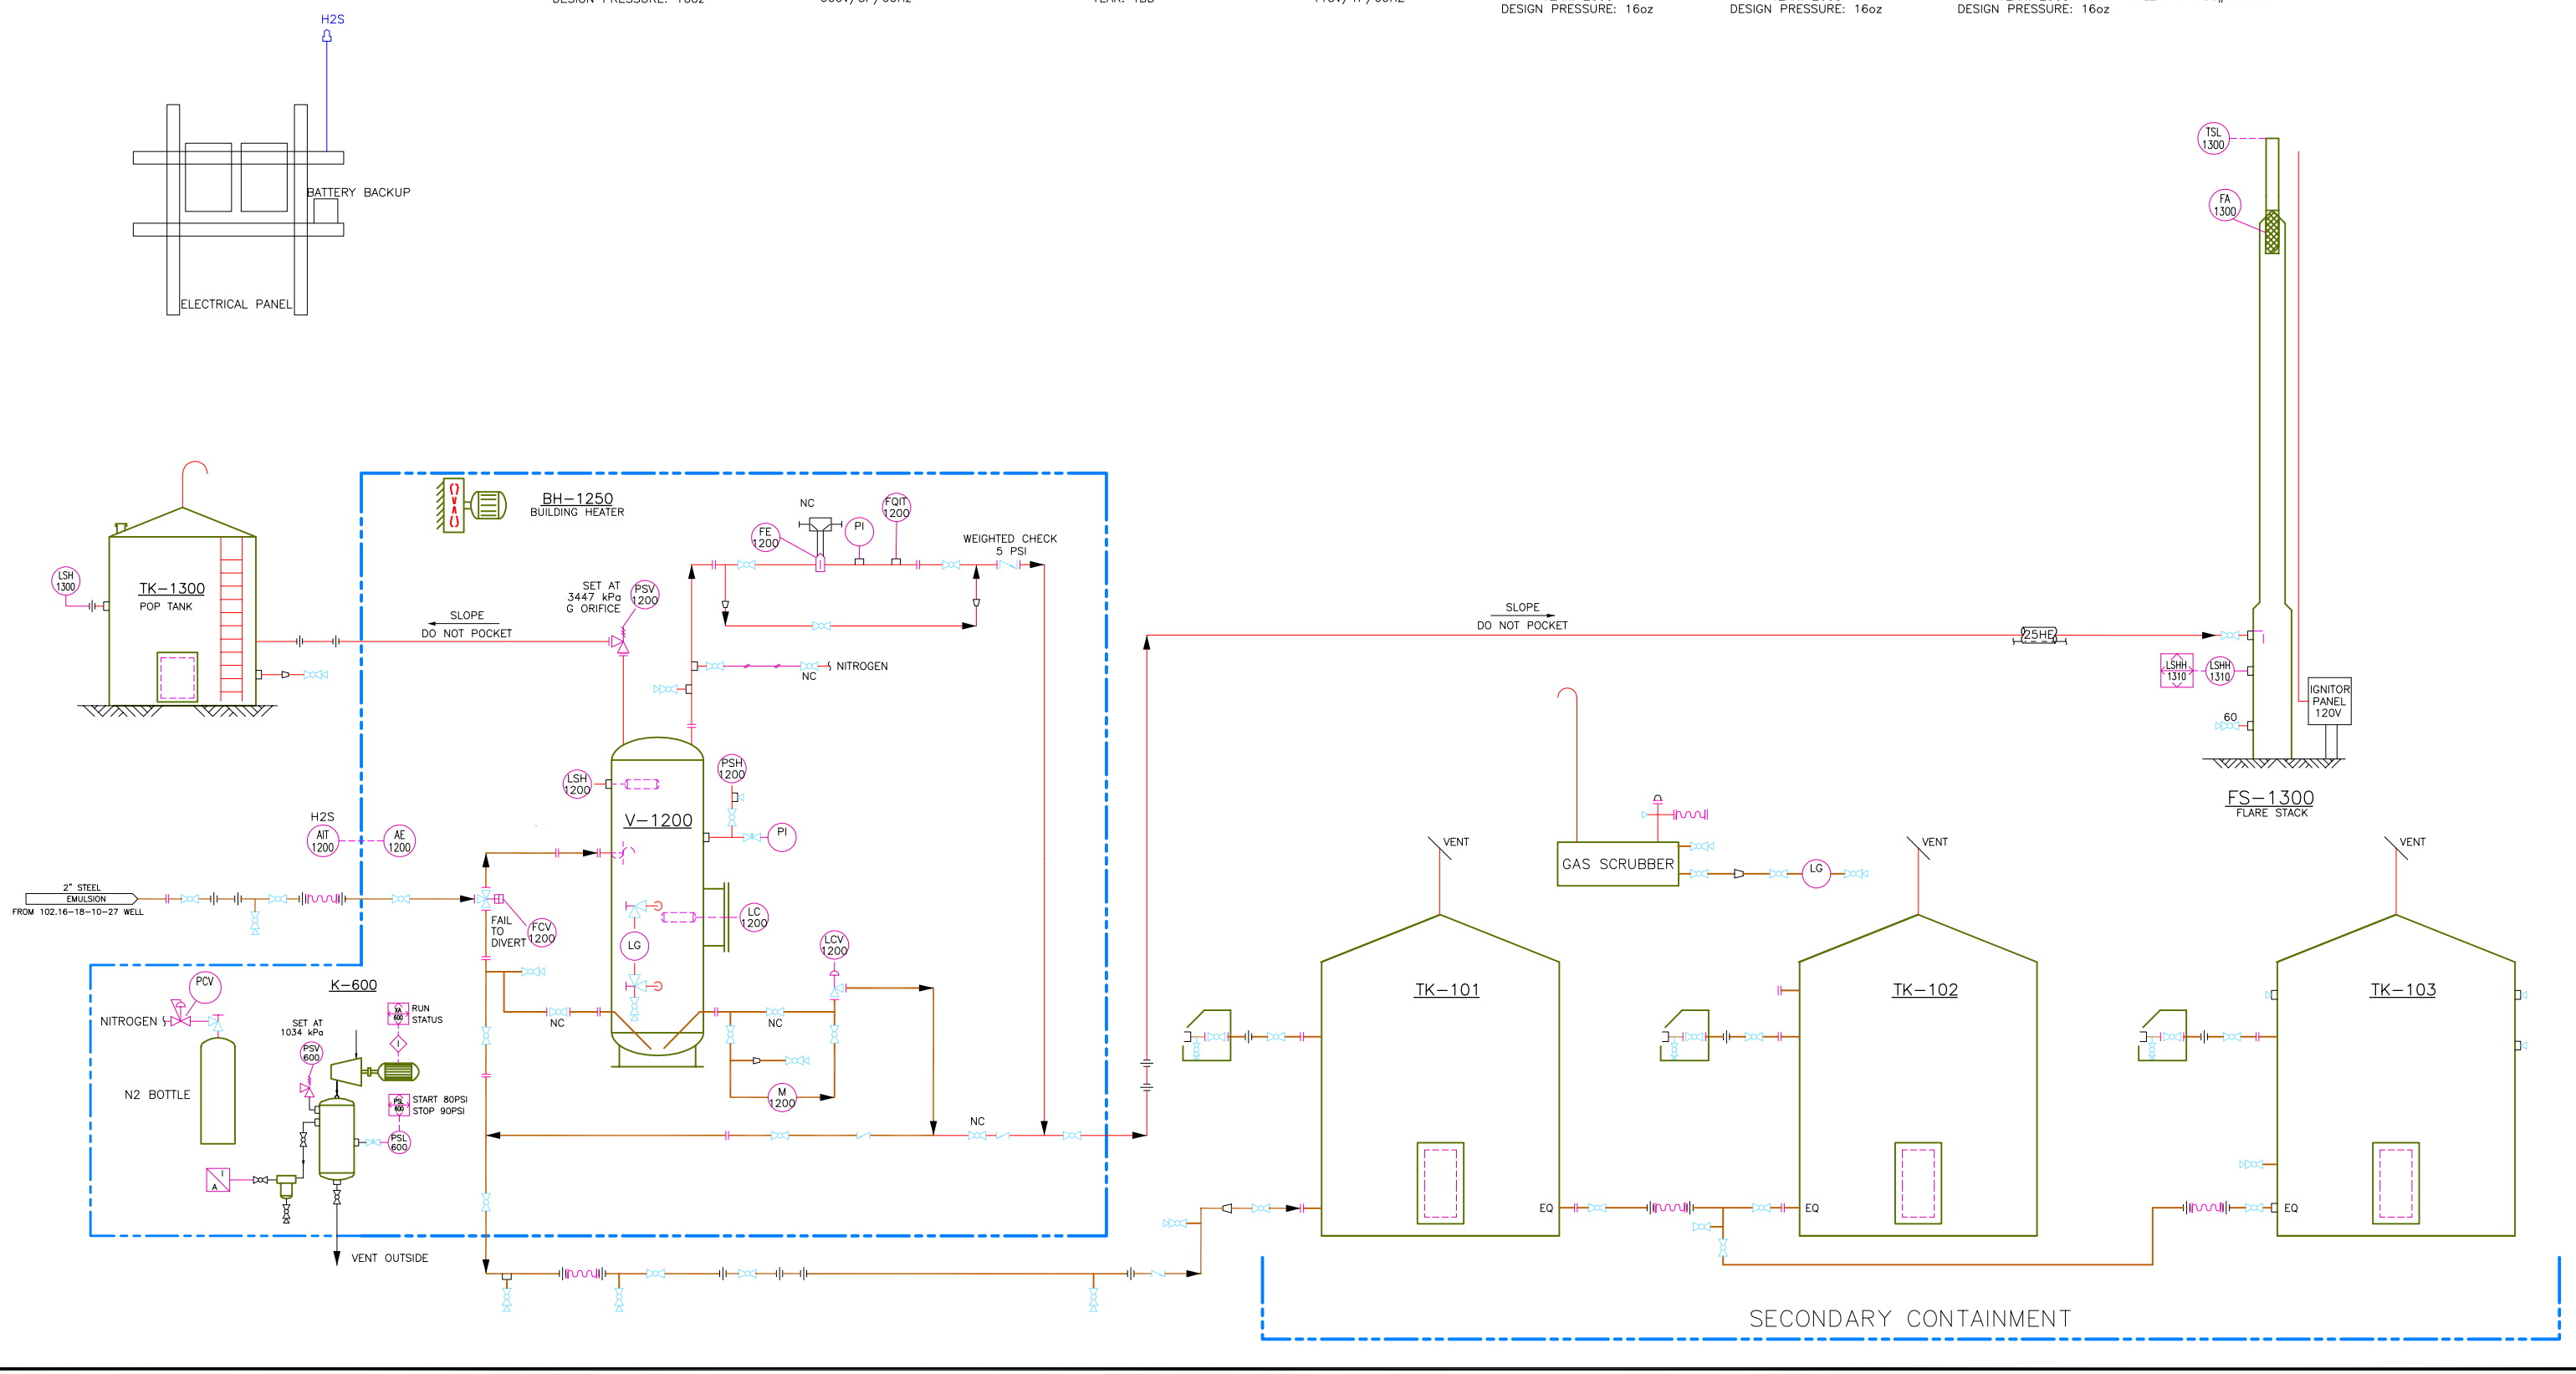

REV	DESCRIPTION	BY	DATE	CHK	APP
0	ISSUED FOR REVIEW	DP	07FEB2024		

REFERENCE DRAWING
–

NOTES:
1. SITE SHUTDOWN TRIPPED BY: AIT-1200, FCV-1300, LSH-1200, LSH-1300, LSHH-1310, PSH-1200

TUNDRA OIL & GAS

DALY
16-07-010-27W1M

PROCESS FLOW DIAGRAM
SINGLE WELL BATTERY

DRAWN BY:	SCALE:	AFE:	DRAWING NUMBER:	REV NO:
DREYSON POTTER	NTS	TBA	16-07-010-27-PFD-1200	0